


TECHNICAL DATA SHEET

PRODUCT: Worcester GB162 Accessories

GB162 TR8 Cascade Frame Kit:

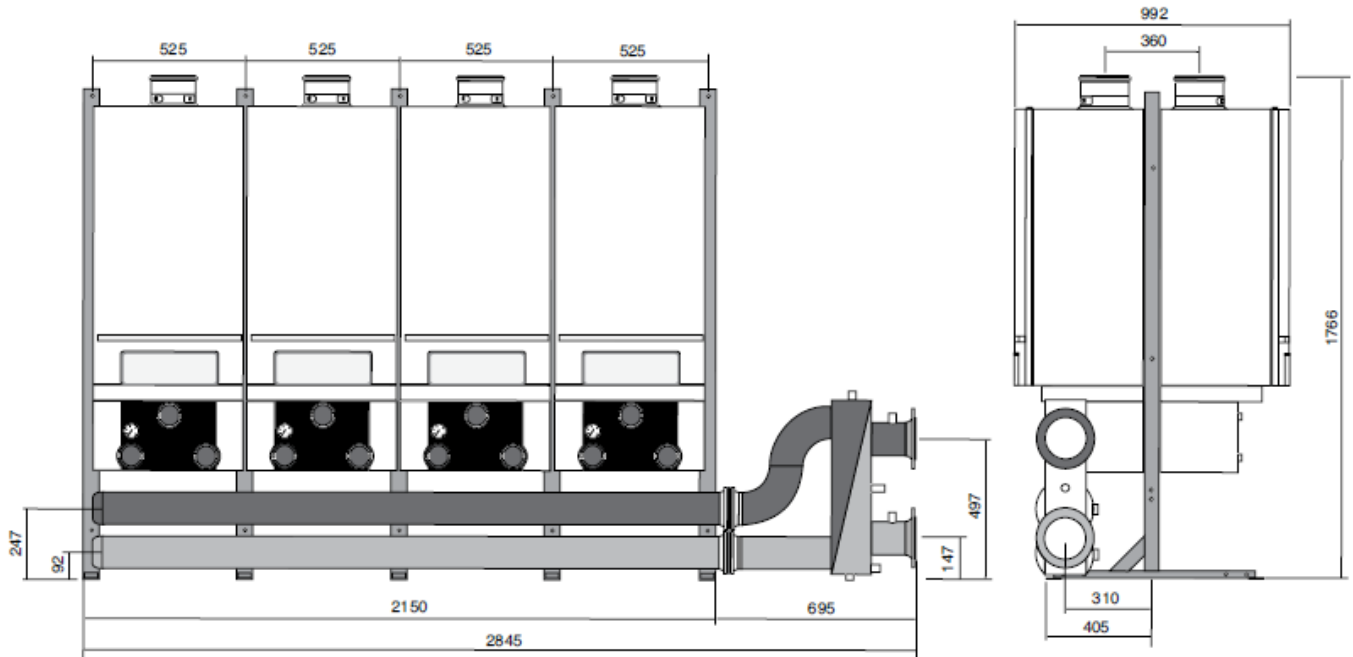

Specification	Unit	TR8 Configuration									
		640	660	680	700	720	740	760	780	800	
Capacity	kW	640	660	680	700	720	740	760	780	800	
GB162 - 80		8	7	6	5	4	3	2	1	-	
GB162 - 100		-	1	2	3	4	5	6	7	8	
Low loss header size	Inch	4									
Flow & return flange connection	mm	100/114.3 PN6 37.2NW									
Main gas pipe connection	Inch	3									
Heating water volume flow @20K	m³/h	27.52	28.38	29.24	31.1	30.96	31.82	32.68	33.54	64.4	
Max. gas consumption NG (G20)	m³/h	71.6	73.18	74.76	76.34	77.92	79.5	81.08	82.66	84.24	
Max. gas consumption LPG (G31)	m³/h	23.20	23.80	24.40	25.00	25.60	26.20	26.80	27.40	28.00	

Required Accessories	Quantity
Variable Speed Pump Group	8

Optional Accessories	Quantity
90° Bend set for 4" LLLH	1

In addition to the above accessories, Worcester has a varying range of flue and control options available to suit the project requirements. Further information regarding these additional products can be obtained via your local sales contact, or alternatively via the commercial heating section of the Worcester website, <http://www.worcester-bosch.co.uk/commercial>

Whilst it is always our intention to fully assist, it is essential to recognise that all information given by the company in response to an enquiry of any nature is provided in good faith and based upon the information provided with the enquiry. We recommend that advice should always be checked with your installer or contract partner. Consequently, the company cannot be held responsible for any liability relating to the use or repetition of such information or part thereof. In addition, whilst making every reasonable effort to monitor the performance and quality of our supply, installation and service network, we do not accept responsibility for the workmanship or operation of any third party company that the company may have promoted either in conversation, e-mail or other communication. Similarly, the views and opinions expressed in communication with individuals within the company may not reflect that of the business as a whole.